FEEDER PILLAR EXTRA LOW VOLTAGE EQUIPMENT LAYOUT

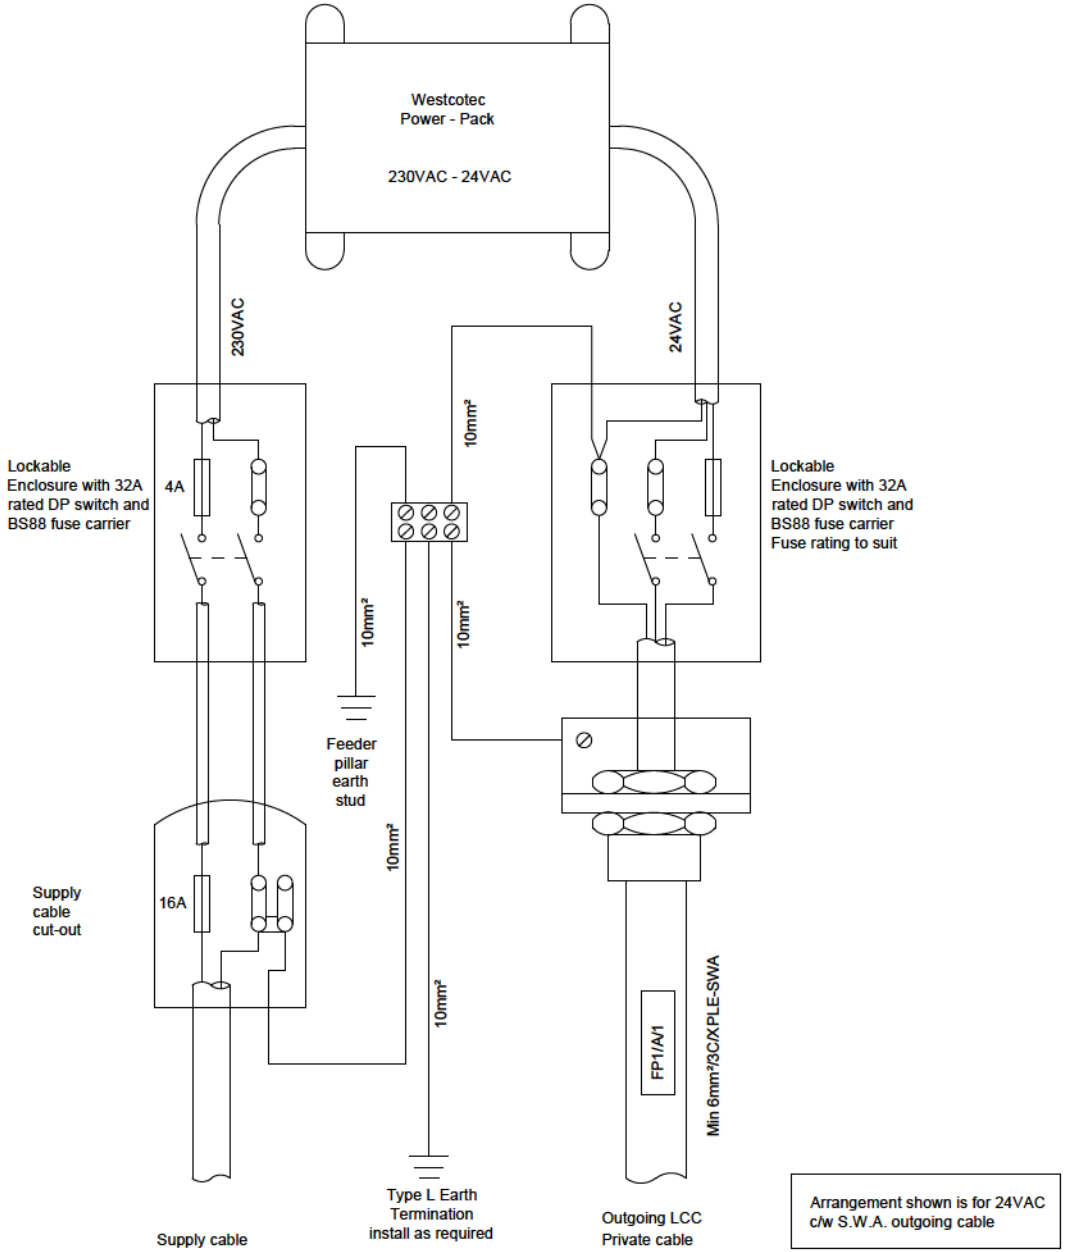

Notes

1. Extra Low Voltage Equipment to be housed in suitable sized feeder pillar of LCC SD/14/1 Series construction.
2. Extra Low Voltage Equipment may be housed in column/wide base post compartment providing adequate space is available to allow for installation/maintenance of equipment and cooling of transformer.
3. Extra low voltage equipment may be <50V AC <120V DC.
4. If 2 core outgoing flex cable is used earth is to be omitted

Rev:	Date:	Description:	Approved by:
A1	04/01/22	Change cable size from 6mm² to 10mm² YEDL removed	PC

AMENDMENT DETAILS

Lincolnshire COUNTY COUNCIL

Checked by:	PC	Approved by:	SB
ISSUED		02/12/14	

Feeder Pillar
Extra Low Voltage Equipment Layout

Electrical Works

SD/14/1H

A1 Revision

This is a typical detail and may require conversion to a full scheme specific drawing.

NOT TO SCALE
(all units in millimetres)

Disclaimer : Before making use of this detail, any designer or third party must ensure that it satisfies all requirements of the scheme to which it is being applied. Lincolnshire County Council accept no responsibility for third party use of this Standard Detail.

SD/14/1H
Standard Detail Number

A1
Revision Number