

Notes

1. 25mm thickness of 0/6mm size close graded surface course to Clause 912.
2. 100mm thickness of 0/20mm size foamed bitumen bound binder course to Clause 974AR.
3. Sub-base 100mm thick to Clause 803 (Type 1).
4. Soft spots to be removed and replaced with either sub-base to Clause 803 in 100mm layers or a 50mm sacrificial layer of 0/20mm dense binder course to Clause 906. The sacrificial layer must be compacted as well as ground conditions permit and allowed to gain maximum stiffness prior to laying subsequent layers.
5. Crossfall is 3% towards carriageway unless otherwise specified.
6. For precast concrete kerb, see Drawing No. SD/11/2.
7. Concrete bed and backing to Grade ST3 to Clause 2602.
8. Mortar bed to be Class 1 to Clause 2404 thickness 10-20mm to Clause 1101.
9. Mortar bed is optional if laying kerbs directly on bed immediately after it is laid.
10. Precast concrete kerbs and edgings to BS 7263.
11. Prepared formation to be sprayed with an approved weed killer.
12. Design is only suitable for the rehabilitation of an existing footway.

Rev: AMENDMENT DETAILS Date: Description: Approved by:




Checked by: GP Approved by: SB


ISSUED 12/05/17

Typical Cross Sections - Footways with Foamed Bitumen Bound Binder Course for Housing Dev. Areas


SD/11/41
Standard Detail Number Revision Number

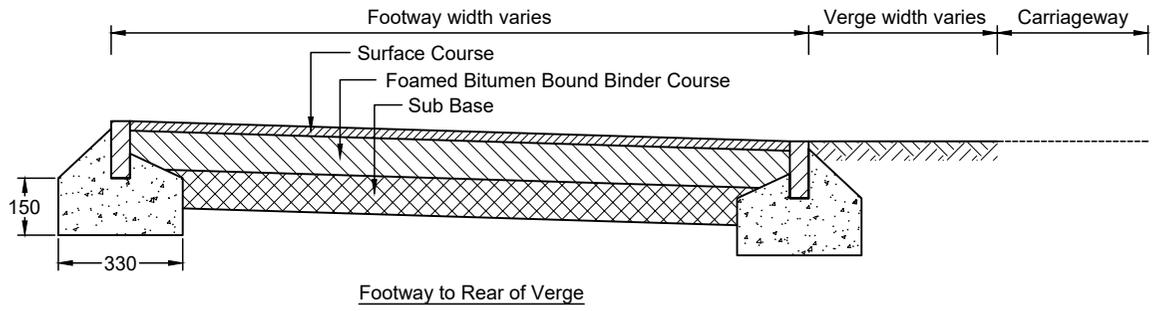

Footway to Rear of Verge

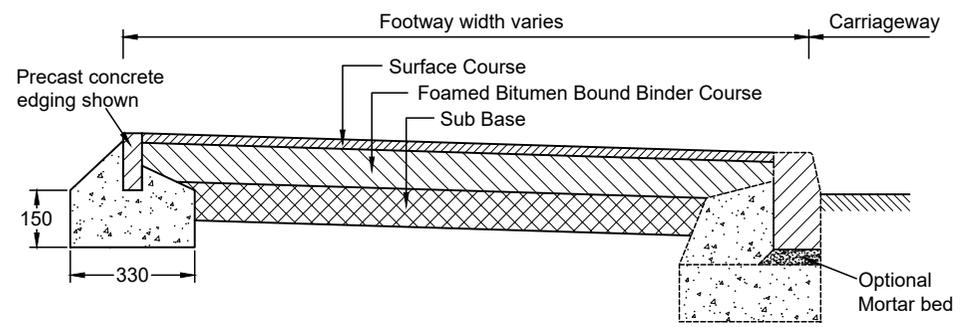

Footway to Rear of Kerb

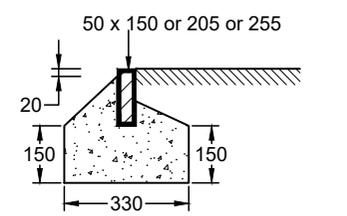

Type 5 Concrete Footway Edging

This is a typical detail and may require conversion to a full scheme specific drawing.

NOT TO SCALE
(all units in millimetres)

Disclaimer : Before making use of this detail, any designer or third party must ensure that it satisfies all requirements of the scheme to which it is being applied. Lincolnshire County Council accept no responsibility for third party use of this Standard Detail.

Revision