


Notes

1. Max pipe diameter 450mm

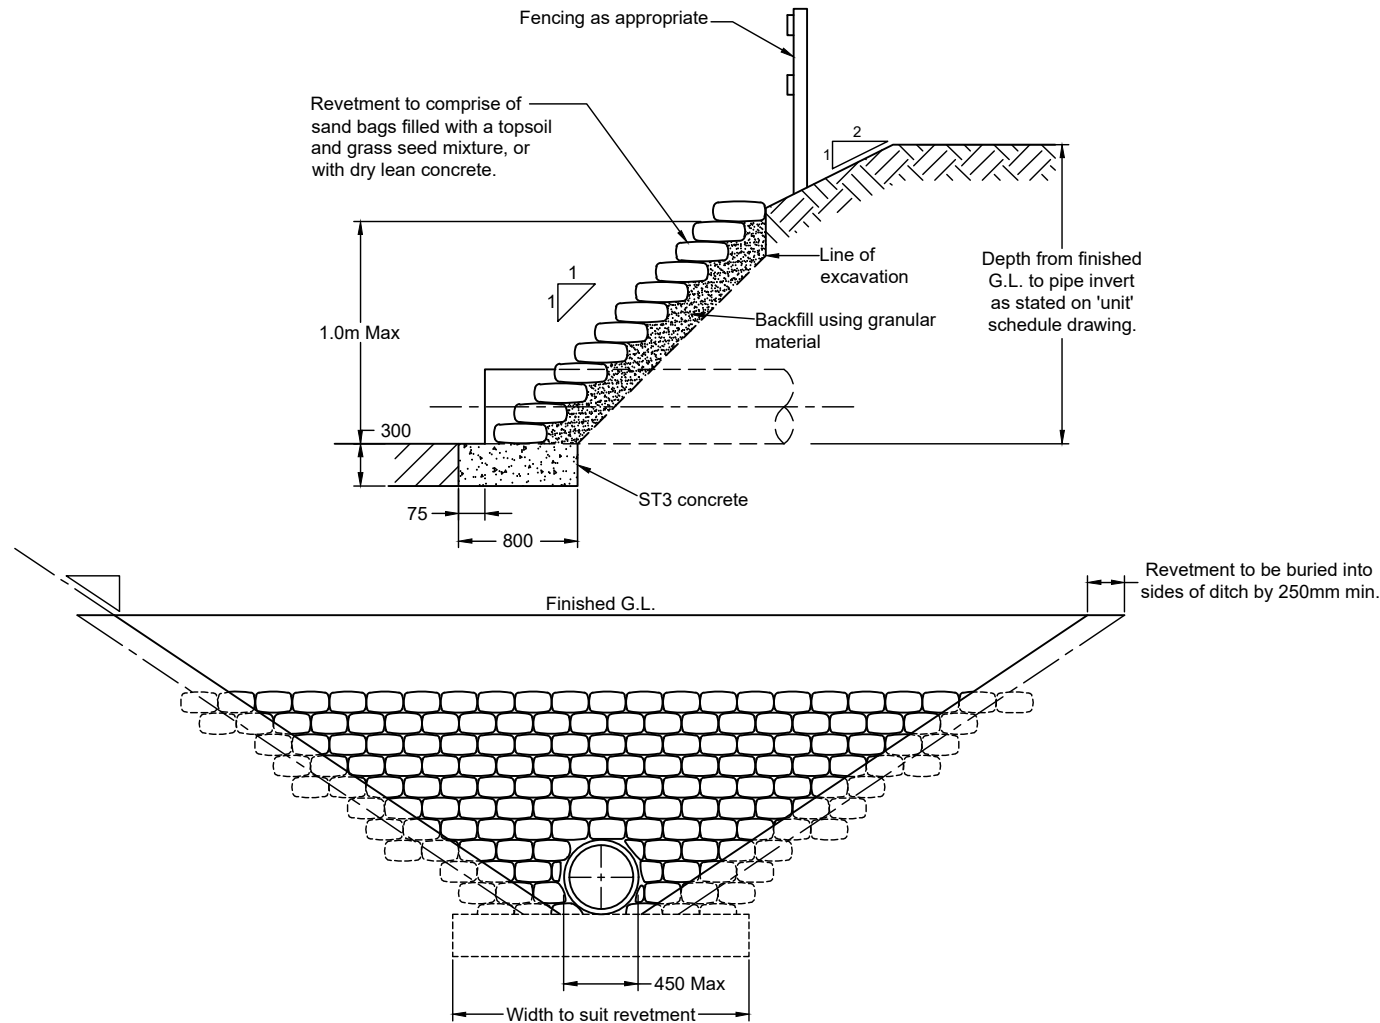

A1	14/01/21	Max Pipe Dia. on sketch to match notes	JM
Rev:	Date:	Description:	Approved by:
AMENDMENT DETAILS			

Lincolnshire
COUNTY COUNCIL
Working for a better future

Checked by:	GP	Approved by:	SB
ISSUED		12/05/17	

Reveted Bagwork Headwalls
for up to 525mm pipe diameter

This is a typical detail and may require conversion to a full scheme specific drawing.

NOT TO SCALE
(all units in millimetres)

Disclaimer : Before making use of this detail, any designer or third party must ensure that it satisfies all requirements of the scheme to which it is being applied. Lincolnshire County Council accept no responsibility for third party use of this Standard Detail.

SD/5/107
Standard Detail Number

A1
Revision Number